

SOUTHWEST RESEARCH INSTITUTE®

6220 CULEBRA ROAD 78238-5166 • P.O. DRAWER 28510 78228-0510 • SAN ANTONIO, TEXAS, USA • (210) 684-5111 • WWW.SWRI.ORG

CHEMISTRY AND CHEMICAL ENGINEERING DIVISION

FIRE TECHNOLOGY DEPARTMENT
WWW.FIRE.SWRI.ORG
FAX (210) 522-3377



STANDARD TEST METHOD FOR SURFACE BURNING CHARACTERISTICS PERFORMED IN ACCORDANCE WITH ASTM E84-20

TRADE NAME: *evoke*
MATERIAL ID: *evoke - variable acoustics panel*

FINAL REPORT
Consisting of 7 Pages

SwRI® Project No.: 01.24918.02.031
Test Date: September 2, 2020
Report Date: September 10, 2020

Prepared for:

Flex Acoustics
NY Carlsbergvej 27, 4th
1760 Copenhagen V
Denmark

Submitted by:

Eugene F. Horton
Principal Engineering Technologist
Material Flammability Section

Approved by:

Matthew S. Blais, Ph.D.
Director
Fire Technology Department

This report is for the information of the client. It may be used in its entirety for the purpose of securing product acceptance from duly constituted approval authorities. This report shall not be reproduced except in full, without the written approval of SwRI. Neither this report nor the name of the Institute shall be used in publicity or advertising.



Benefiting government, industry and the public through innovative science and technology

Executive Summary

This report presents the test results for a specimen submitted by Flex Acoustics, located in Denmark, and tested at Southwest Research Institute's (SwRI's) Fire Technology Department, located in San Antonio, Texas. The test is conducted in accordance with the procedure outlined in ASTM E84-20, *Standard Test Method for Surface Burning Characteristics of Building Materials* (NFPA 255, ANSI/UL 723 and UBC 8-1).

Material ID: *evoke - variable acoustics panel*

- Flame Spread Index (FSI): 0
- Smoke Developed Index (SDI): 60

Test Criteria.

Classification	Flame Spread Index	Smoke Developed Index
A	0 – 25	0 – 450
B	26 – 75	0 – 450
C	76 – 200	0 – 450

1.0 INTRODUCTION

The purpose of this test method is to determine the relative burning behavior according to the standard ASTM E84-20 of materials by observing the flame spread along the specimen. Flame Spread and Smoke Developed index are reported in Appendix A. However, there is not necessarily a relationship between these two measurements.

Test specimens are conditioned as appropriate in an atmosphere maintained between 68° and 78 °F and 45% to 55% relative humidity. Immediately prior to the test, the specimen is mounted in the furnace with the side to be tested facing the test flame. Cement board is placed on the unexposed side of the specimen to protect the furnace lid assembly. Sometimes, because of the nature of the material undergoing testing, additional support (e.g. wire, wire and rods, rods, and/or bars) is used to ensure that the specimen will remain in position during the test. The use of supporting materials on the underside of the test specimen may lower the Flame Spread Index from that which might be obtained if the specimen could be tested without such support, and the test results do not necessarily relate to indices obtained by testing materials without such support.

Two model building codes (2015 International Building Code®, Chapter 8 *Interior Finishes*, Section 803 *Wall and Ceiling Finishes*; NFPA 5000, Chapter 10 *Interior Finish*, Section 10.3 *Interior Wall or Ceiling Finish Testing and Classification*) classify materials based on the Flame Spread and Smoke Developed indices.

This standard should be used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions and should not be used to describe or appraise the fire-hazard or fire-risk of materials, products, or assemblies under actual fire conditions. However, results of the test may be used as elements of a fire-hazard assessment or a fire-risk assessment which takes into account all of the factors which are pertinent to an assessment of the fire hazard or fire risk of a particular end use.

The results apply specifically to the specimens tested, in the manner tested, and not to the entire production of these or similar materials, nor to the performance when used in combination with other materials. More detailed results with graphical illustrations may be found in Appendix A.

ASTM E84-20 REPORT

2.0 DESCRIPTION OF SPECIMEN

MATERIAL ID:*	<i>evoke - variable acoustics panel</i>
TRADE NAME:*	evoke
DATE RECEIVED:	August 24, 2020
DESCRIPTION:*	Steel panel with opening louvers and 24v motor
THICKNESS:	250 mm (nominal)
WEIGHT:	59.6 kg (nominal)
COLOR:	Black
SUBSTRATE:	N/A
ADHESIVE:	N/A
SPECIMEN SIZE:	2438 × 600 mm (nominal) (3 pieces)
COMPOSITION:*	Steel (99.5%), magnetic tape, double sided gluing tape, 24 v motor
CONSTRUCTION:*	The front face is 2 mm steel. Each panel weighs about 60 kg. The material was tested with the louvers in the closed position.
PREPARED BY:	Ready-to-test
CONDITIONING TIME:	7days at 73.4 °F ± 5 °F, (23 °C ± 2.8 °C), 50% ± 5% humidity
SUPPORT USED:	None
WITNESSED BY:	N/A

* From Client's material description and/or instructions

APPENDIX A
TEST RESULTS
(CONSISTING OF 2 PAGES)

Client: Flex Acoustics
SwRI Project No.: 01.24918.02.031
Test Date: September 2, 2020
Material I.D.: *evoke - variable acoustics panel*

TEST RESULTS

ROUNDED FLAME SPREAD INDEX (FSI):	0
ROUNDED SMOKE DEVELOPED INDEX (SDI):	60

TEST DATA

UNROUNDED FSI:	0
UNROUNDED SDI:	61.3
FS*TIME AREA (Ft*Min):	0.0
SMOKE AREA (%*Min):	60.3
FUEL AREA (°F*Min):	4108.1

OBSERVATIONS DURING TEST


IGNITION TIME (Min: S):	01:20
MAXIMUM FLAME FRONT ADVANCE (Ft.):	0.0
TIME TO MAXIMUM ADVANCE (Min: S):	1:00
MAXIMUM TEMP. AT EXPOSED TC (°F):	460
TIME TO MAXIMUM TEMP. (Min: S):	9:51
TOTAL FUEL BURNED (Cu. Ft.):	1490.0
DRIPPING (Min: S):	None
FLAMING ON FLOOR (Min: S):	None
AFTERFLAME TOP (Min: S):	None
AFTERFLAME FLOOR (Min: S):	None
SAGGING (Min: S):	None
DELAMINATION (Min: S):	None
SHRINKAGE (Min: S):	None
FALLOUT (Min: S):	None

CALIBRATION DATA

HEPTANE SMOKE AREA (%*Min):	88.4
RED OAK FUEL AREA (°F*Min):	5077
GRC BOARD FUEL AREA (°F*Min):	4645

Client: Flex Acoustics
SwRI Project No.: 01.24918.02.031
Test Date: September 2, 2020
Material I.D.: *evoke - variable acoustics panel*

LIGHT OBSCURATION

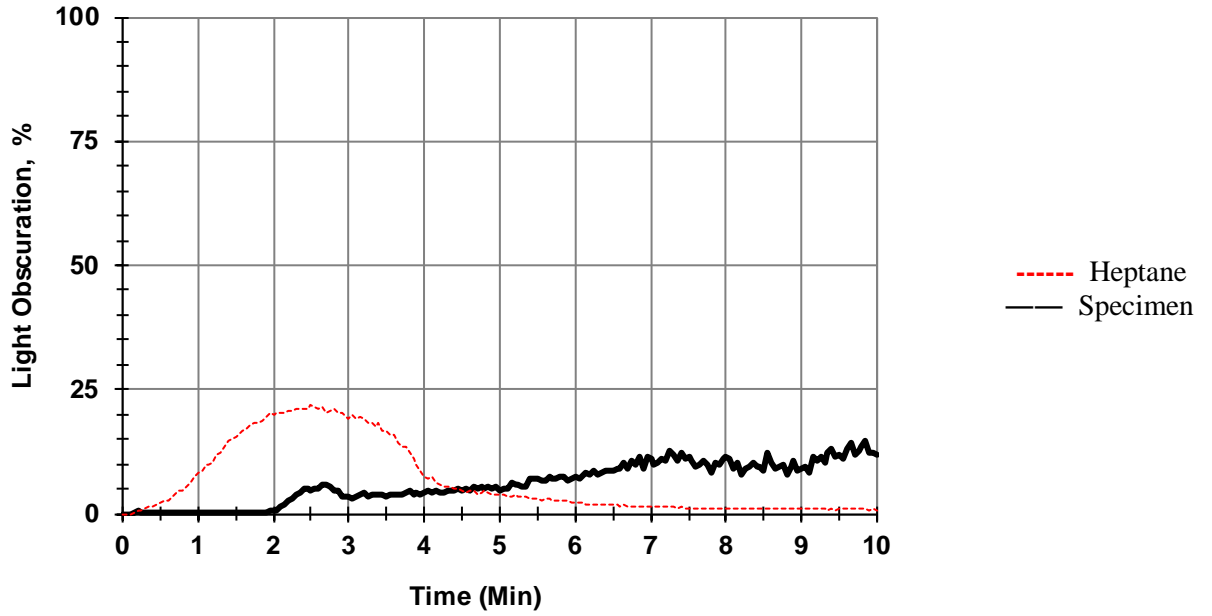

FLAMESPREAD

